


ASK71.2U Frame Mount Kit

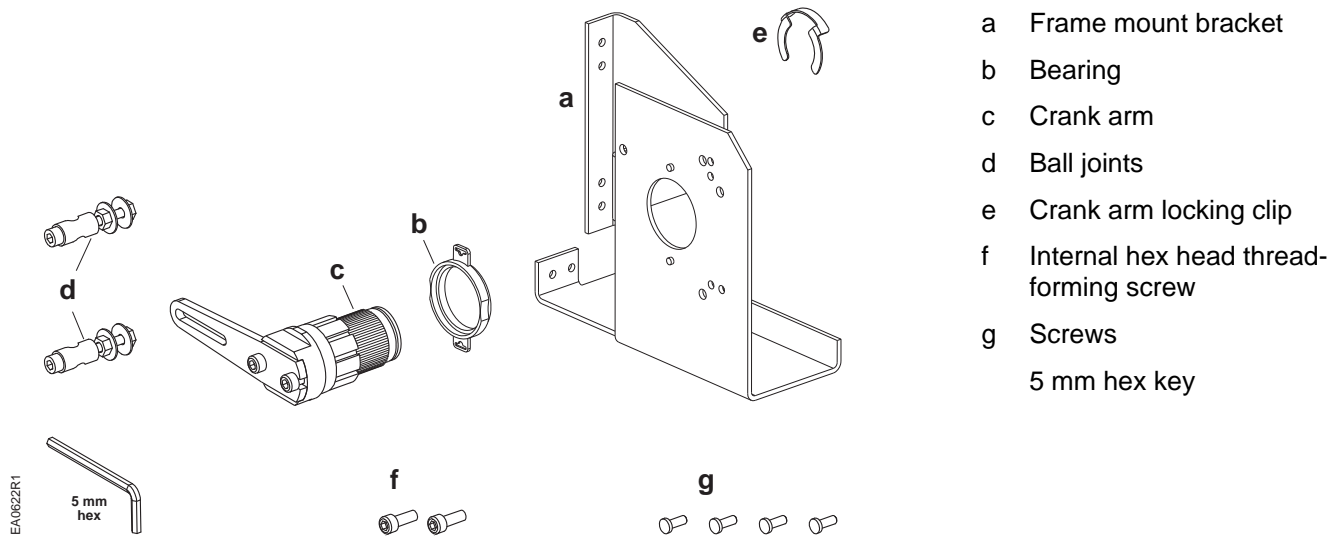

- a Frame mount bracket
 - b Bearing
 - c Crank arm
 - d Ball joints
 - e Crank arm locking clip
 - f Internal hex head thread-forming screw
 - g Screws
- 5 mm hex key

Figure 1. Contents of ASK71.2U Kit.

Product Description

This kit provides for the frame mounting of the GCA GBB, and GIB OpenAir™ actuators.

Product Numbers

ASK71.2U

Installation Conventions

WARNING		Personal injury/loss of life may occur if a procedure is not performed as specified.
CAUTION		Equipment damage or loss of data may occur if the user does not follow procedure as specified.

Required Tools

- Phillips screwdriver
- 5 mm hex key (provided)

Expected Installation Time

30 minutes

Prerequisites

Obtain proper length 1/4 or 5/16 inch (6.3 or 7.9 mm) diameter steel push rod.

Installation

1. Attach the mounting bracket to the damper frame using the four sheet metal screws (item g, *Figure 1*).
2. If necessary, remove the shaft adapter from the actuator.

Attaching the Actuator to the Bracket.

1. Place the actuator on the bracket.

GCA (spring return): Place the label with the counterclockwise rotation arrow next to the bracket.

GBB/GIB (non-spring return): Place the non-label side next to the bracket.

2. Fasten the actuator to the bracket using the two internal hex head screws.
3. Tighten the screws with a 5 mm hex key.
4. Place the bearing in the opening of the bracket.

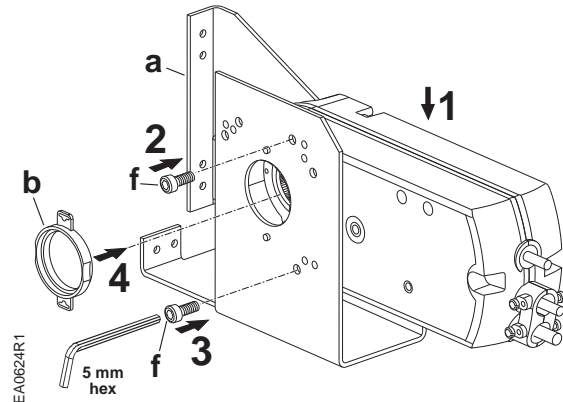


Figure 2.

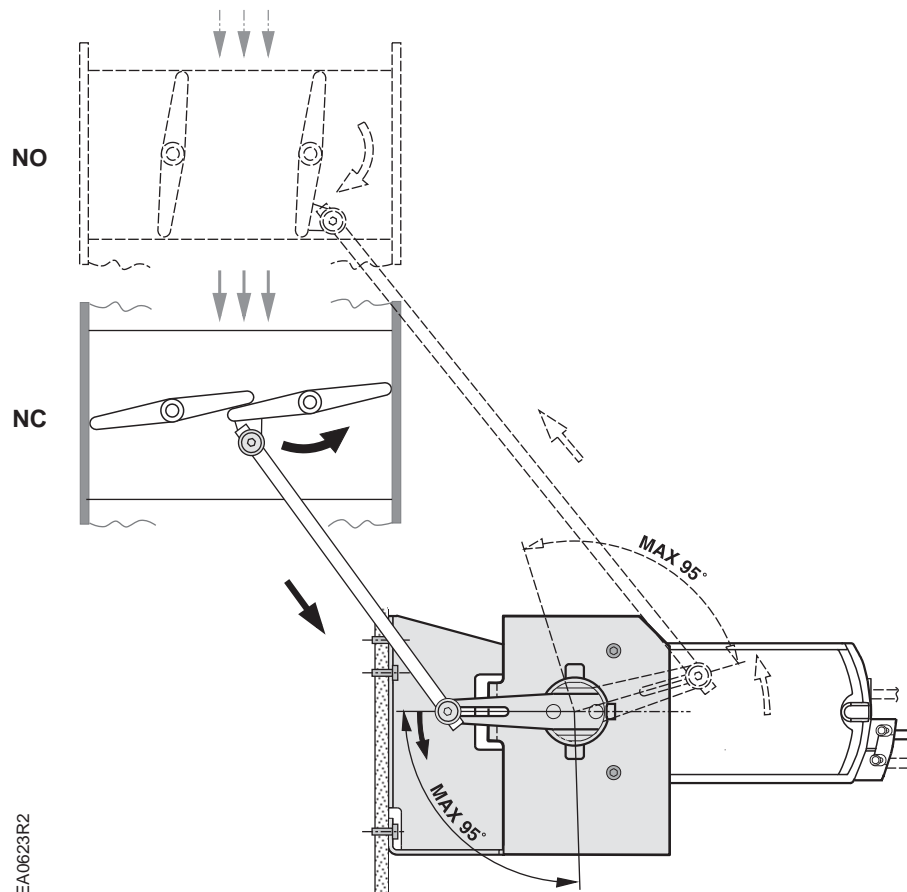


Figure 3. Crank Arm Position for Normally Open and Normally Closed Applications.

Attaching the Crank Arm and Push Rod.

Refer to *Figure 3* to determine the crank arm position depending on whether the damper blades are normally open or normally closed.

1. Insert the crank arm in the actuator.
2. Fasten the locking clip over the crank arm.
3. Insert a push rod in a ball joint.
4. Using a 5 mm hex key, fasten the ball joint and push rod to the crank arm.

NOTE: The ball joint can be attached from 2 to 3-1/2 inches (50 to 90 mm) from the center of the crank arm. Refer to *Figure 5*.

5. Slip the other ball joint over the push rod.
6. Using a 5 mm hex key, attach the push rod and ball joint to the damper blade.
7. Make any push rod adjustments to get the desired operation.

The installation is complete.

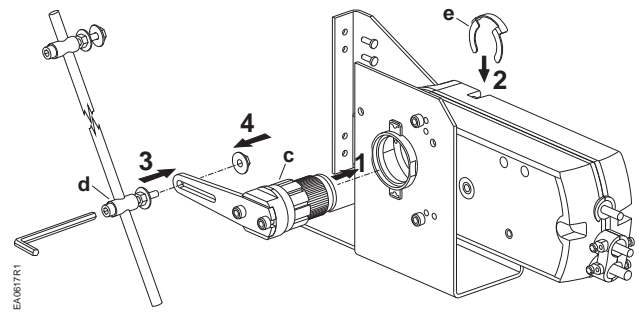


Figure 4.

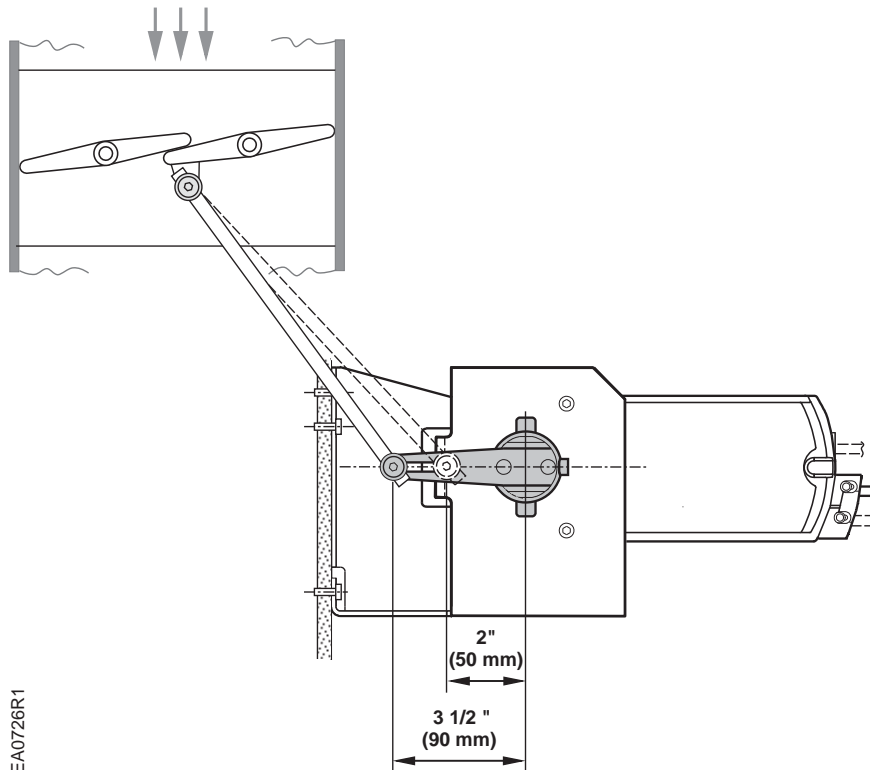


Figure 5.

Dimensions

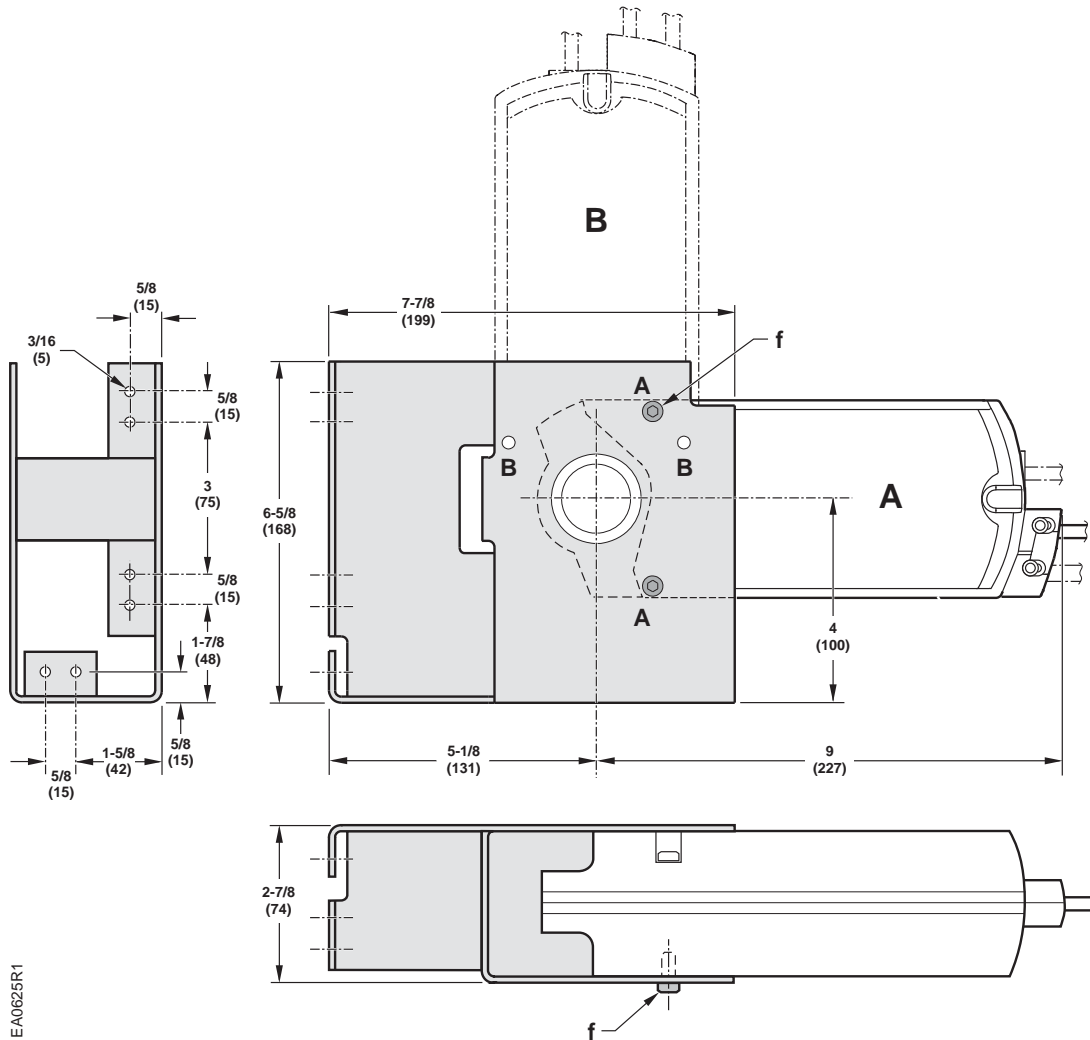


Figure 6. Dimensions in inches (millimeters).

References

Installation instructions

GCA Spring Return Rotary Electronic Damper Actuator 129-218

GBB/GIB Non-Spring Return 3-position Control Rotary Electronic Damper Actuator 129-244

GBB/GIB Non-Spring Return Modulating Control Rotary Electronic Damper Actuator 129-222

Information in this publication is based on current specifications. The company reserves the right to make changes in specifications and models as design improvements are introduced. OpenAir is a registered trademark of Siemens Industry, Inc. Product or company names mentioned herein may be the trademarks of their respective owners. © 2009 Siemens Industry, Inc.